

# FIRE ALARM

## Explosionproof Fire Alarm Systems

### STANDARD FEATURES

Fire alarm call stations, for installation in hazardous atmosphere locations where emergency control of fire alarm or signal circuits is required.

Station is painted red for easy identification. Housing and break glass hammer are cast aluminum alloy. Exposed operator parts are red anodized aluminum.

A yellow adhesive backed label "Caution-Stand Clear of Area in Front of Glass to Protect Eyes from Flying Glass", furnished for application above the alarm station.




### COMPLETE ASSEMBLY

Catalog Number with 3/4" NPT conduit opening top and bottom	Catalog Number with 1" NPT conduit opening top and bottom
XHFA 31-N4	XHFA 41-N4
XHFA 32-N4	XHFA 42-N4
XHFA 33-N4	XHFA 43-N4

Replacement Glass: Catalog Number XHFG

### MAXIMUM CURRENT RATINGS FOR CONTROL CIRCUIT CONTACTS

Volts	Make Amperes	Break Amperes	Continuous Carrying
120	60	6	10

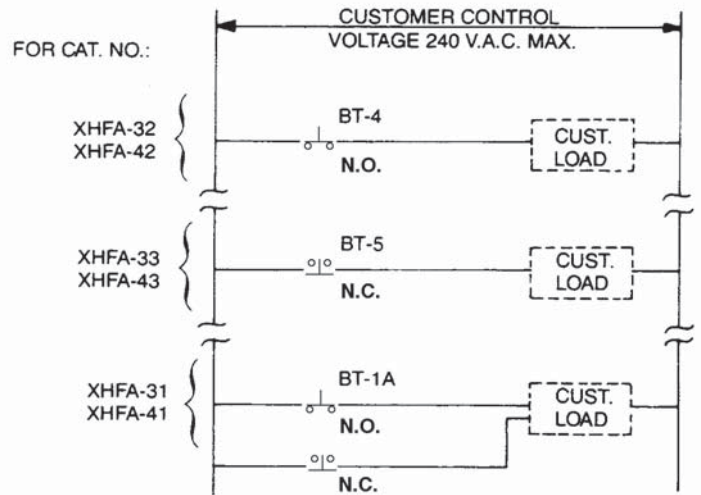

**NOTES** Contact blocks furnished as standard  
Contacts are shown as held in their actuated position.

### CERTIFICATIONS

- Class I, Division 1, Groups C & D
- Class II, Groups E, F, G
- Type 4
- UL Standard 689
- UL Standard UL38 manually activated signaling boxes for use with Fire Protection Signaling Systems

