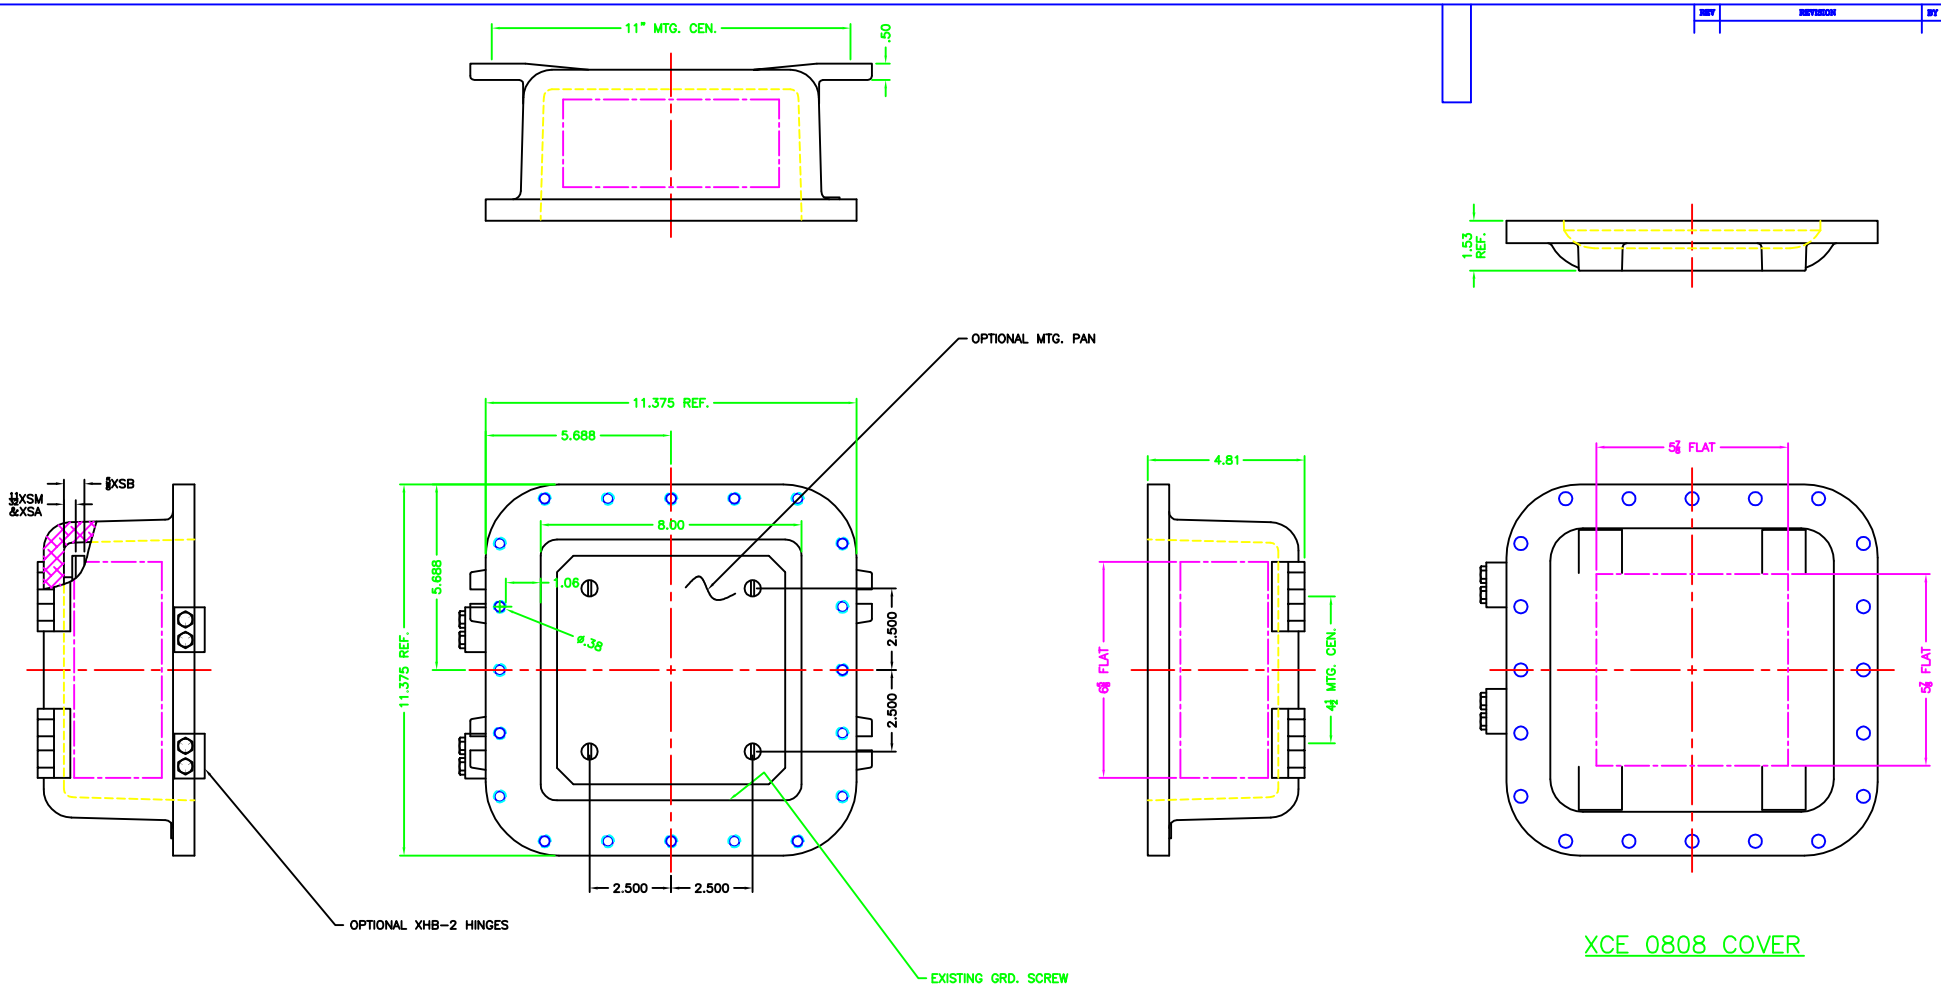

XCE 0808 COVER

NOTES:

COVER DRILLING ALLOWABLE IN XCE ONLY

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS $1\frac{1}{16}$.
2. MINIMUM SPACING BETWEEN $\frac{3}{4}$–14 NPSM OPERATOR CENTERS IS $2\frac{1}{2}$ FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 4.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE 3/8 BOLT.

REV	REVISION	BY	ECN	DATE

ADALET
A SCOTT FETZER COMPANY
Electronic Systems · Cable Accessories

TITLE: MODIFIED XCE/XJF 080804 ENCLOSURE FOR

DRAWN BY	DDH	DATE	6-12-01
ENG APPROVAL		PLOT SCALE	1=2
MFG APPROVAL		SIZE	D
ENG NO		SHT	1OF1

FINISH: TUMBLAST
MOD NO: XCE/XJF 080804