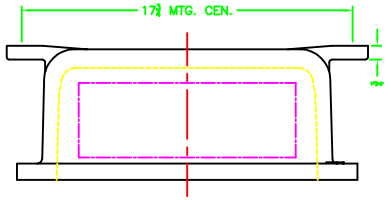



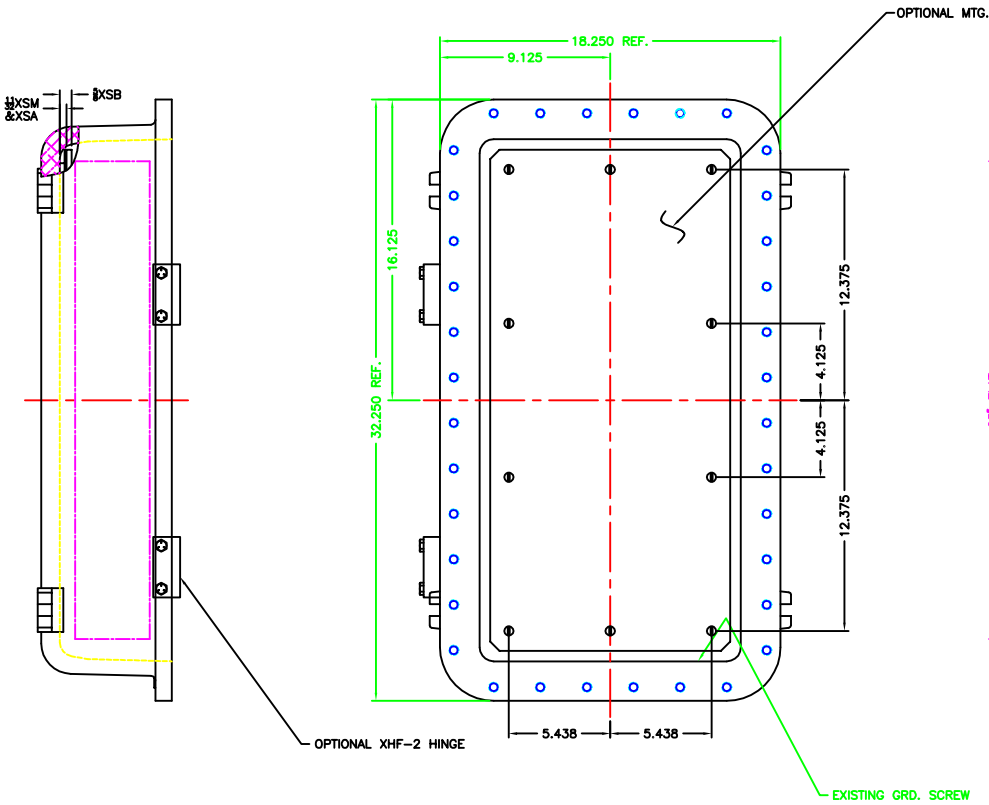

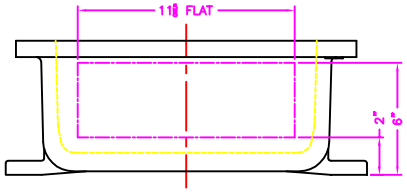

XCE 1428 COVER

NOTES:

COVER DRILLING ALLOWABLE IN XCE ONLY

1. MINIMUM SPACING FROM CENTER OF OPERATOR TO NEAREST FLAT IS 1⅛.
2. MINIMUM SPACING BETWEEN ¾-14 NPSM OPERATOR CENTERS IS 3 FOR THIS ENCLOSURE.
3. MAXIMUM NUMBER OF OPERATORS IS 32.
4. DIMENSION FROM CENTER LINES OF COVER FOR OPERATORS.
5. DIMENSION FROM CENTER LINE AND BACK OF MTG. LUG FOR CONDUIT.
6. FOR MTG. ENCLOSURE USE ½ BOLT.

REV	REVISION	BY	BCH	DATE

ADALET
A SCOTT FETZER COMPANY
Enclosure Systems · Cable Accessories

TITLE: MODIFIED XCE/XJF 142806 ENCLOSURE FOR

DRAWN BY	DDH	DATE	11-13-01
ENG APPROVAL		PLOT SCALE	1=3.5
MFG APPROVAL		SIZE	D
MATERIAL	SEE NOTES	DWG NO	
FINISH	TUMBLAST		
PART NO	XCE/XJF 142806		1OF1